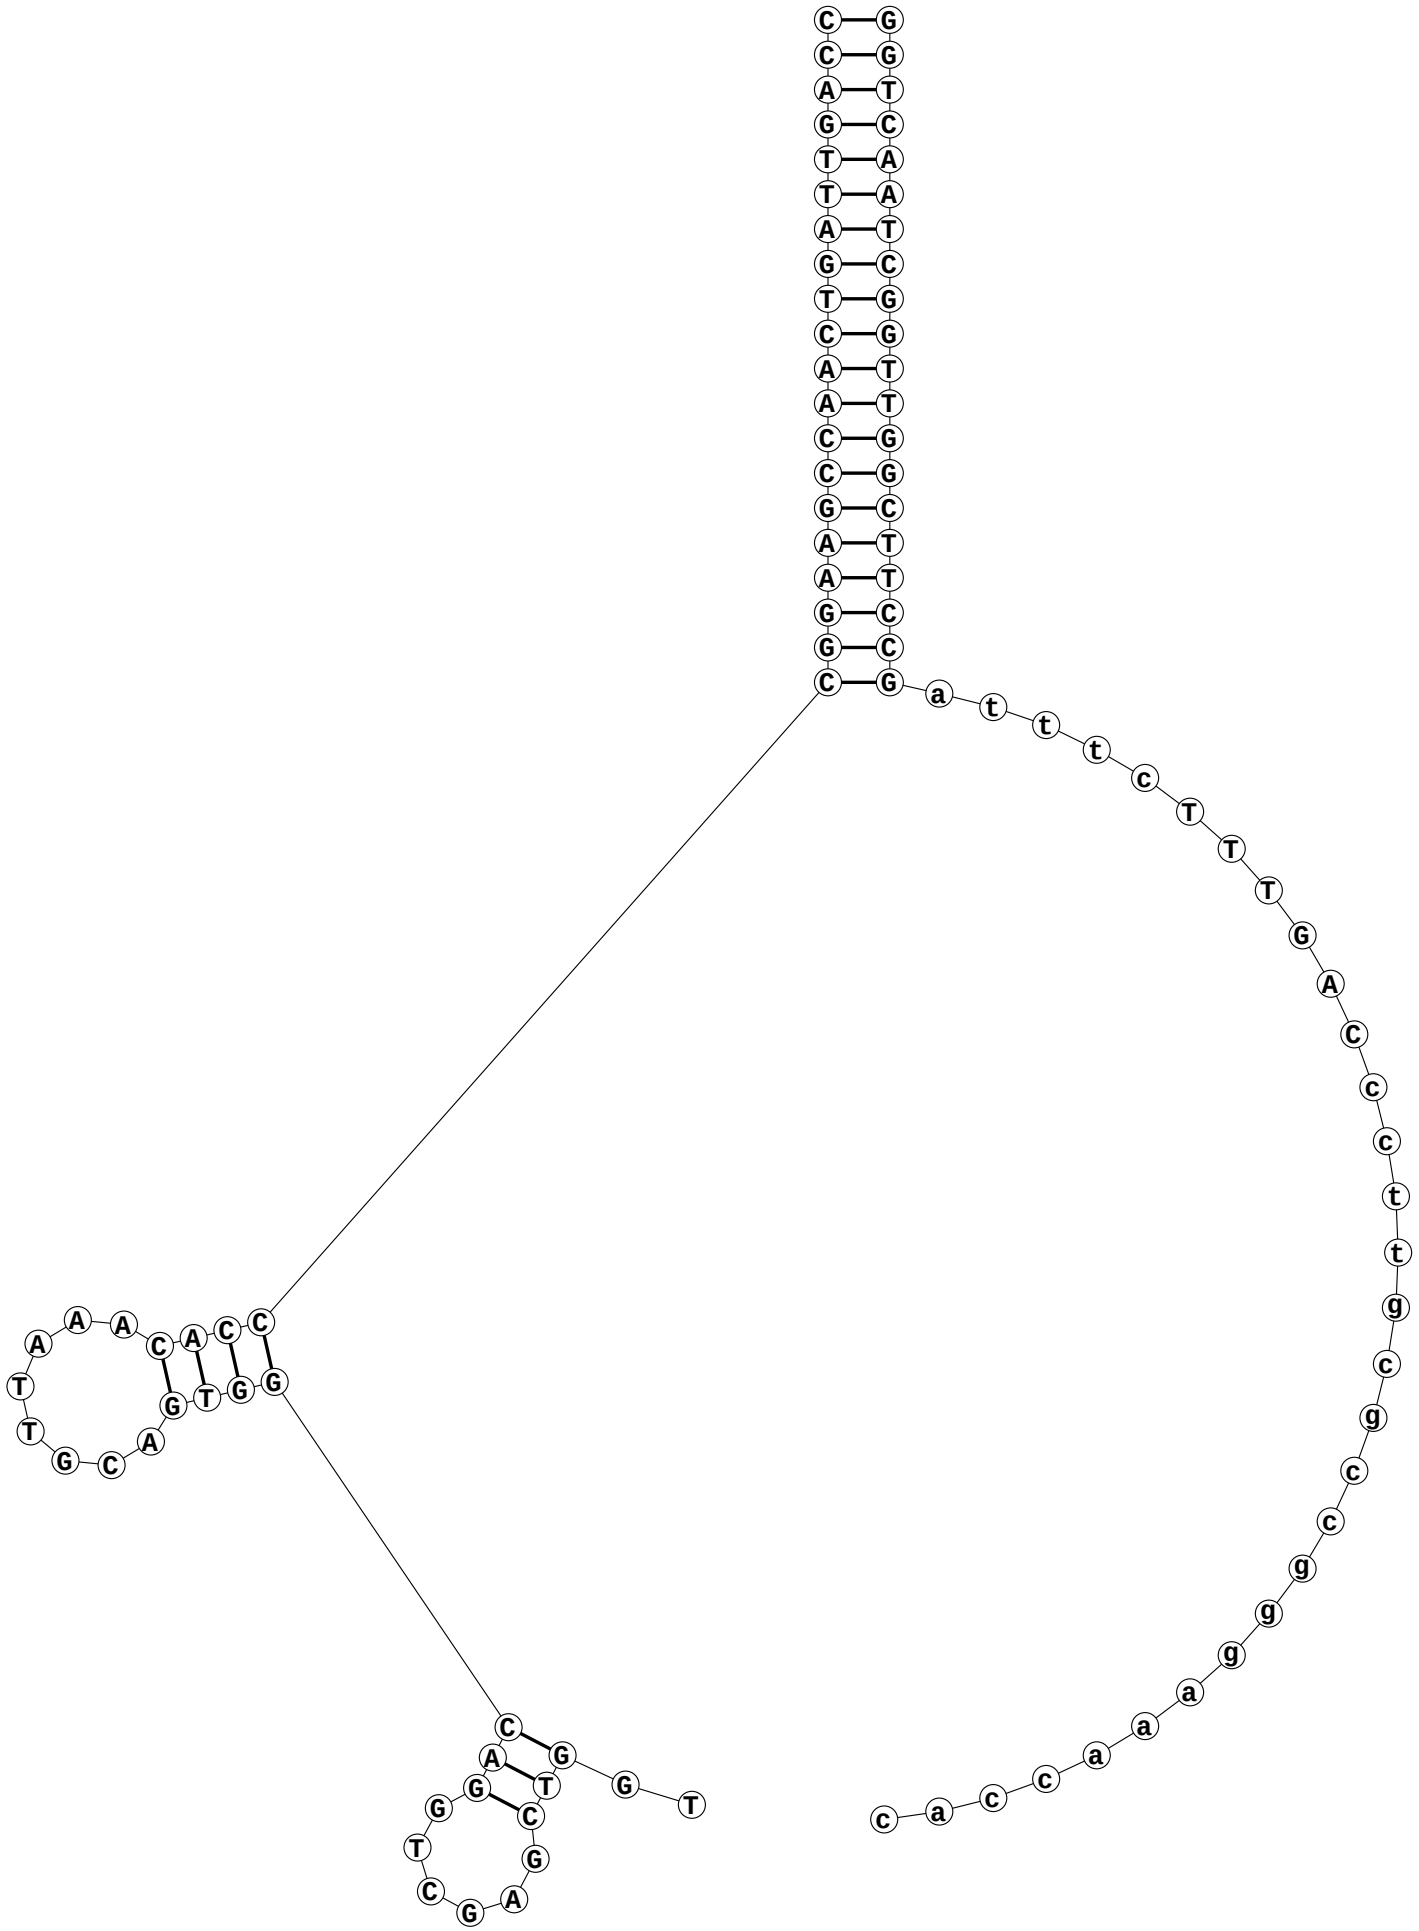

ENERGY = -45.1 Intended_ IGS

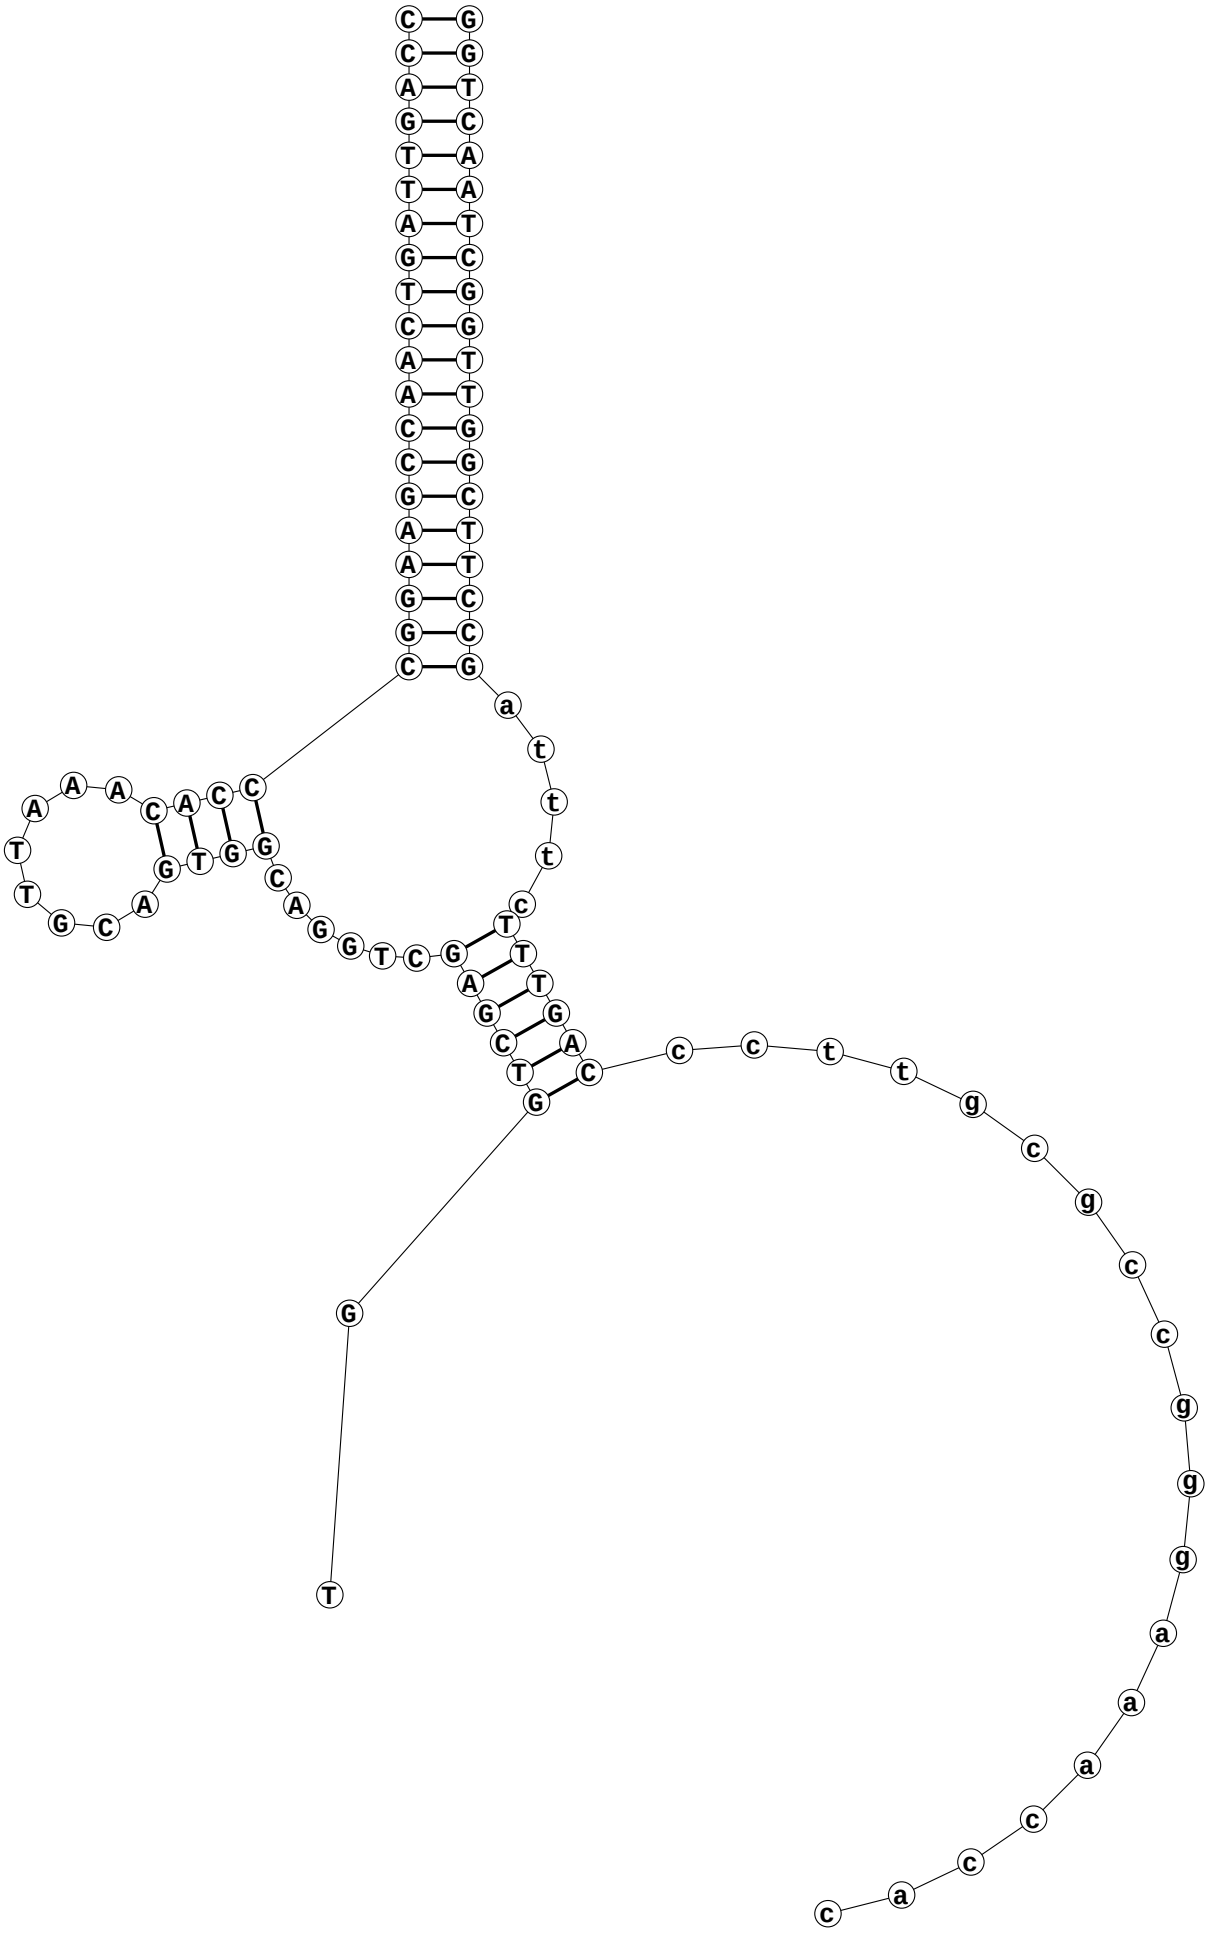

ENERGY = -44.9 Intended_ IGS

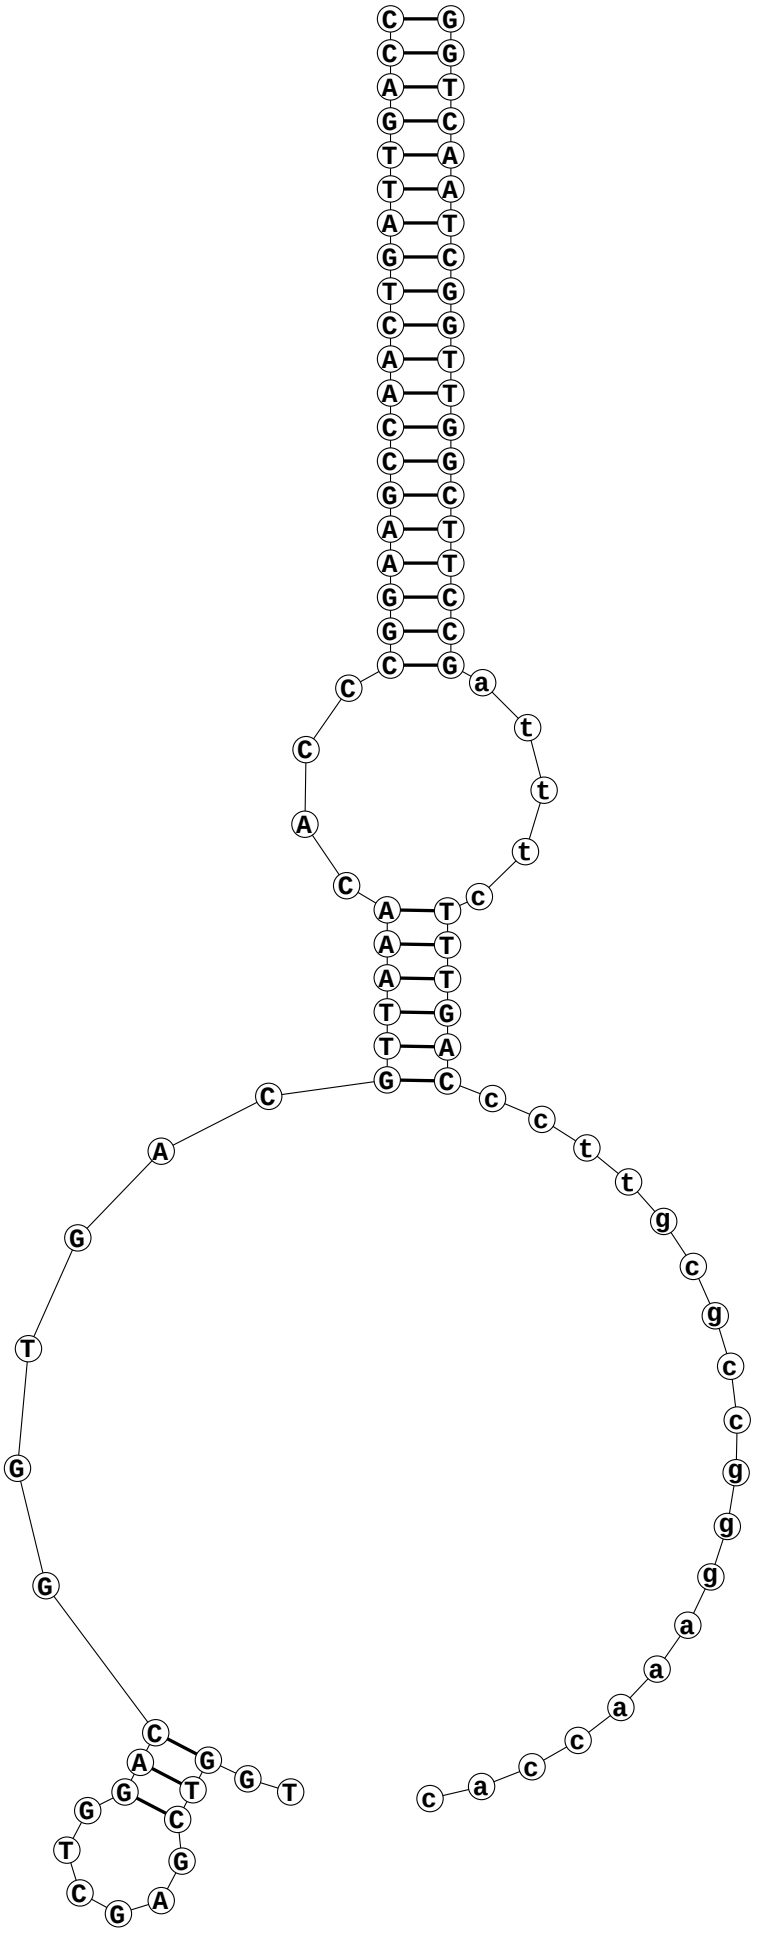

ENERGY = -43.8 Intended_ IGS

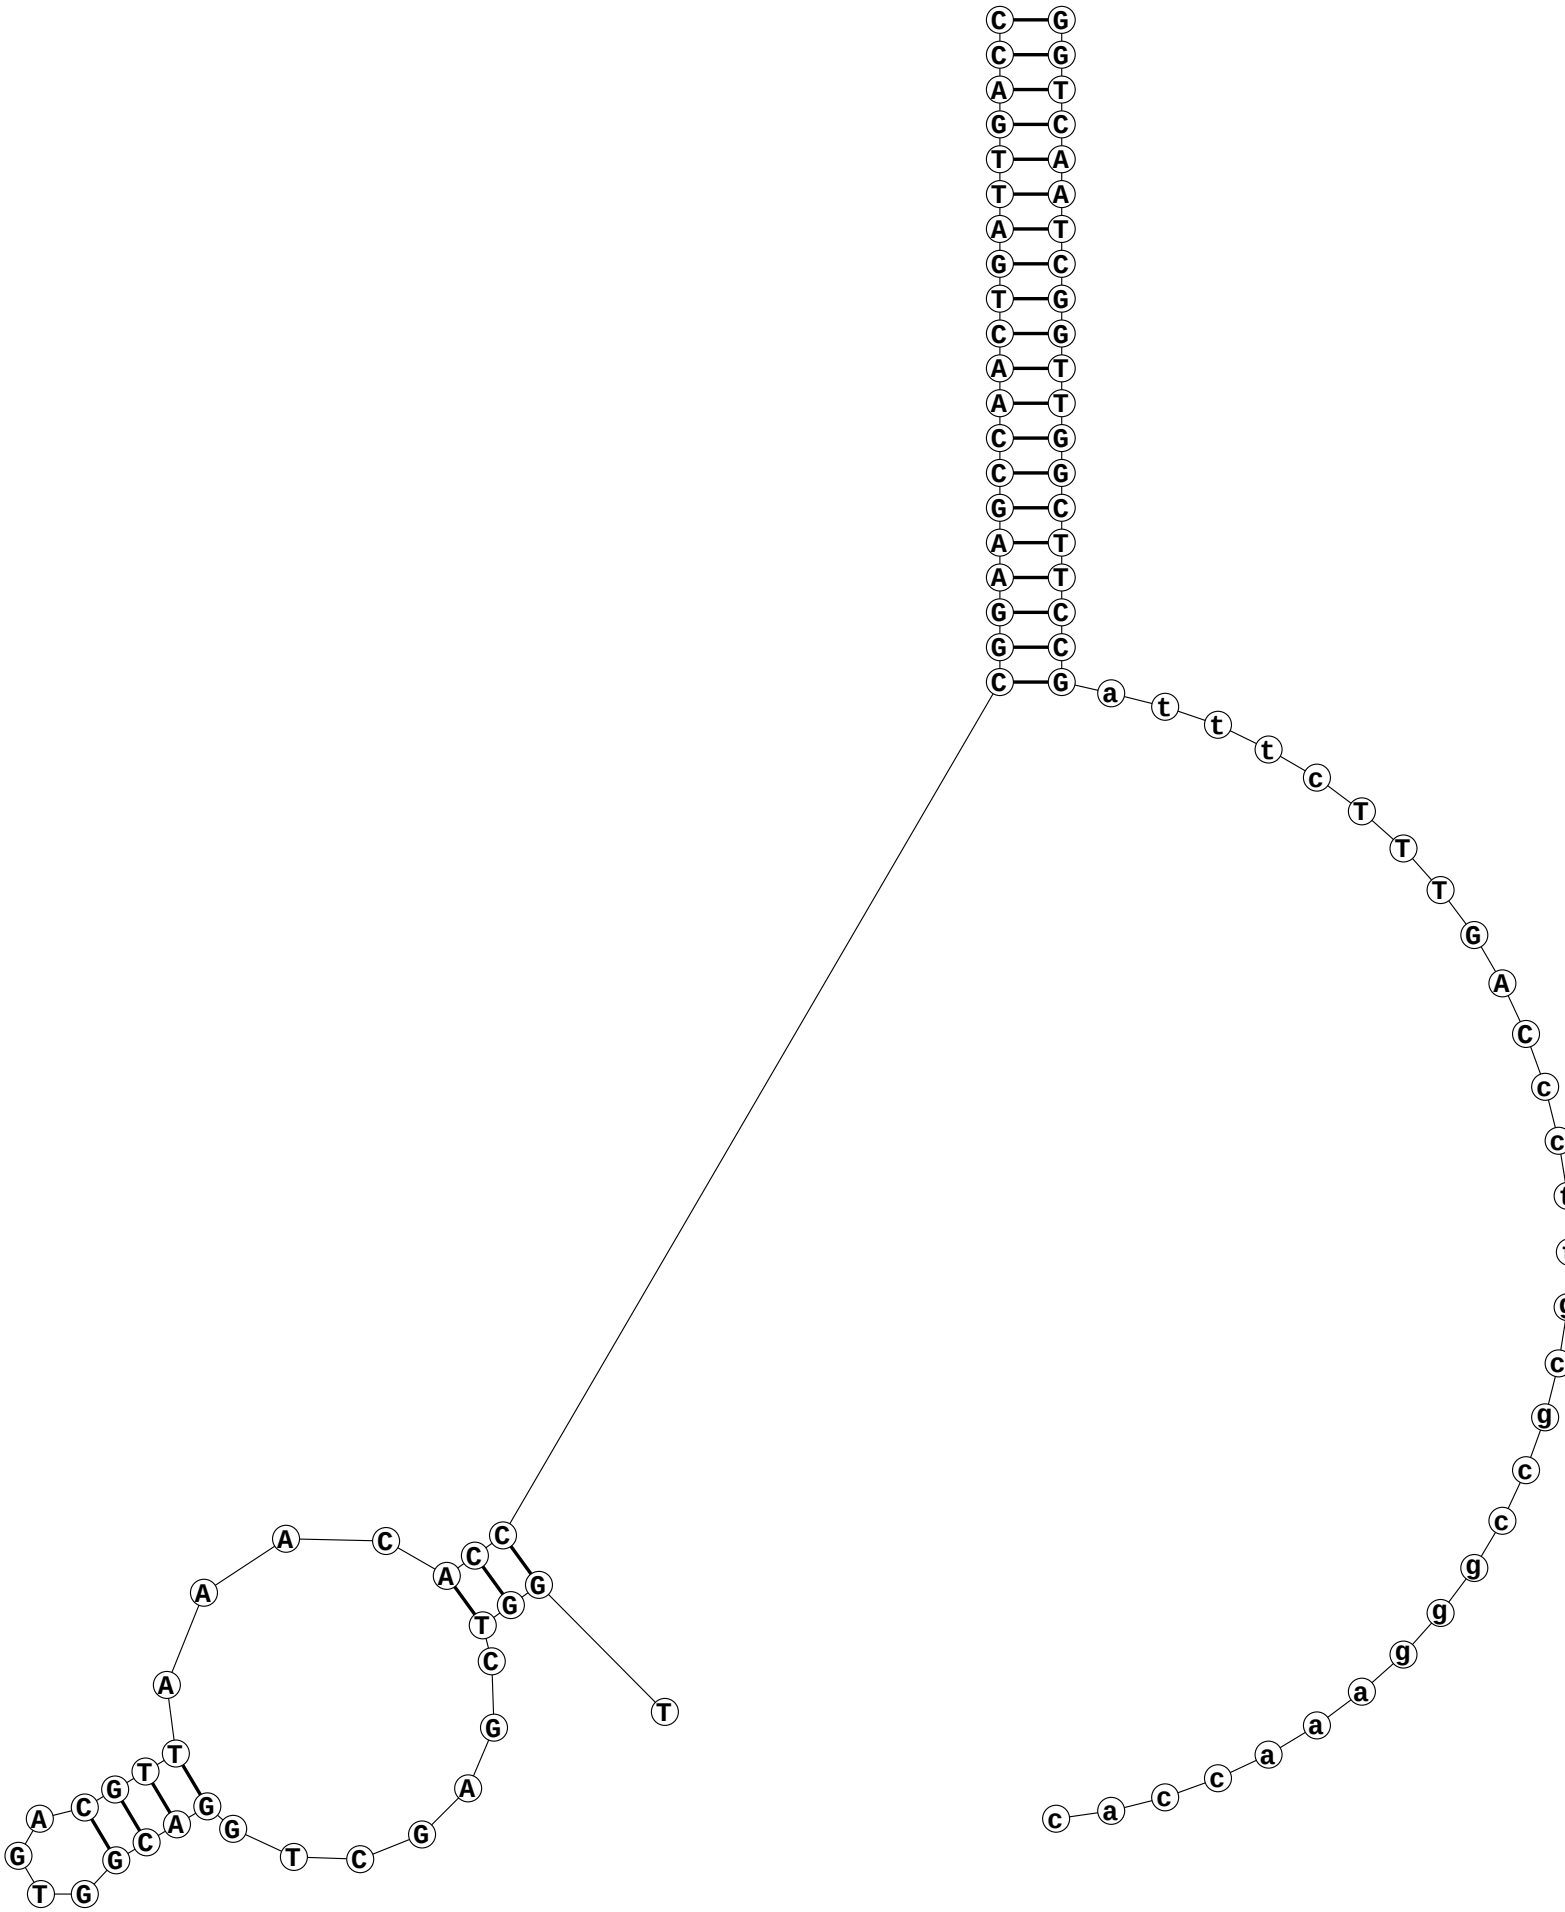

ENERGY = -43.4 Intended_ IGS